


FLOOD

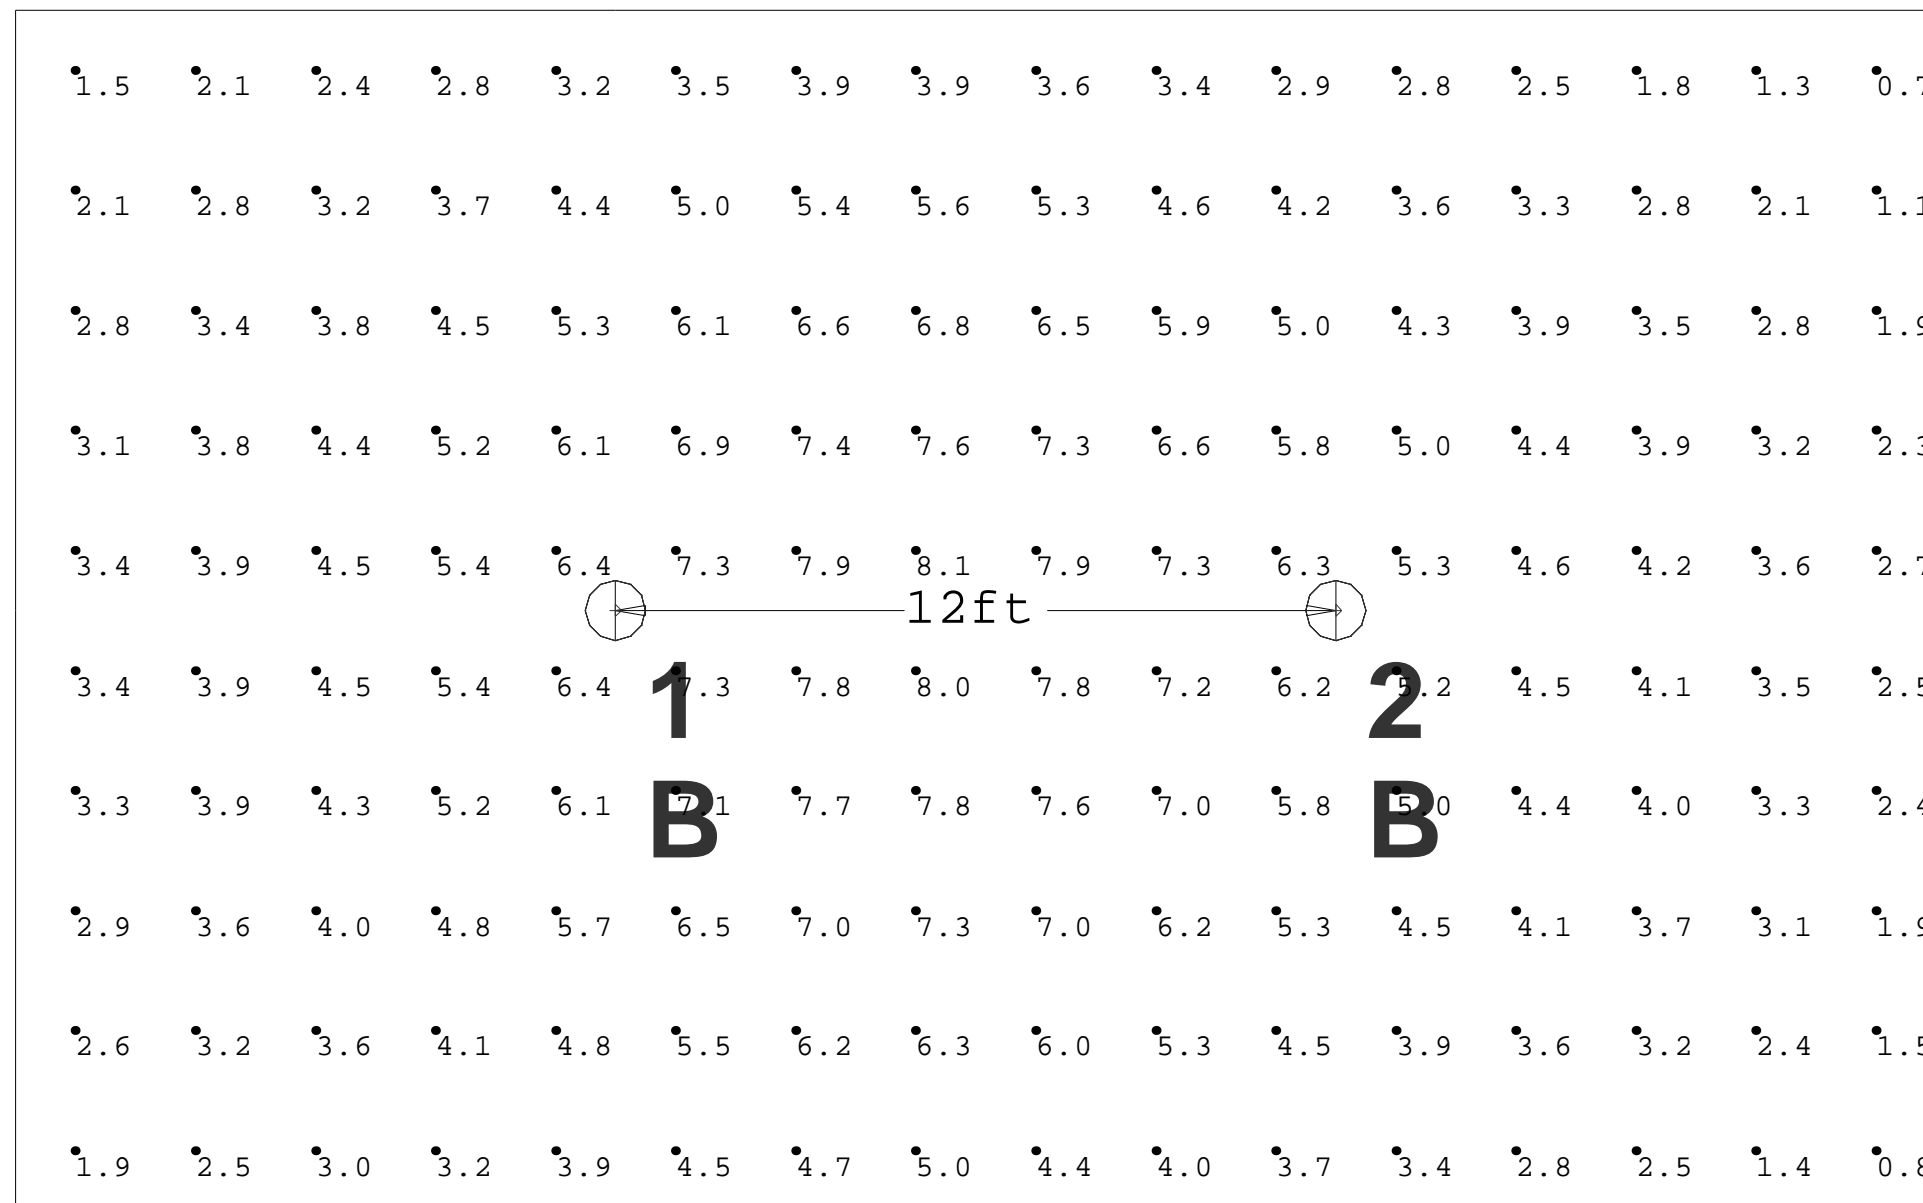


Luminaire Schedule						
Symbol	Qty	Label	Arrangement	Lumens/Lamp	PLF	Description
⊕	2	A	SINGLE	N.A.	0.800	TDB4W-LED-1-7-6-_-_-54 W INGROUND LED SPOT FIXT
⊕	2	B	SINGLE	N.A.	0.800	TDB4W-LED-1-7-4-_-_-54 W INGROUND LED FLOOD FIXT

Calculation Summary						
Label	Units	Avg	Max	Min	Avg/Min	Max/Min
CalcPts	Fc	4.47	8.1	0.7	6.39	11.57
SPOT	Fc	3.23	13.0	0.0	N.A.	N.A.

Luminaire Location Summary			
Label	LumNo	Z	Tilt
B	1	25	0
B	2	25	0
A	3	25	0
A	4	25	0

Notes:
1. Calculation 25' from fixtures.

SPOT

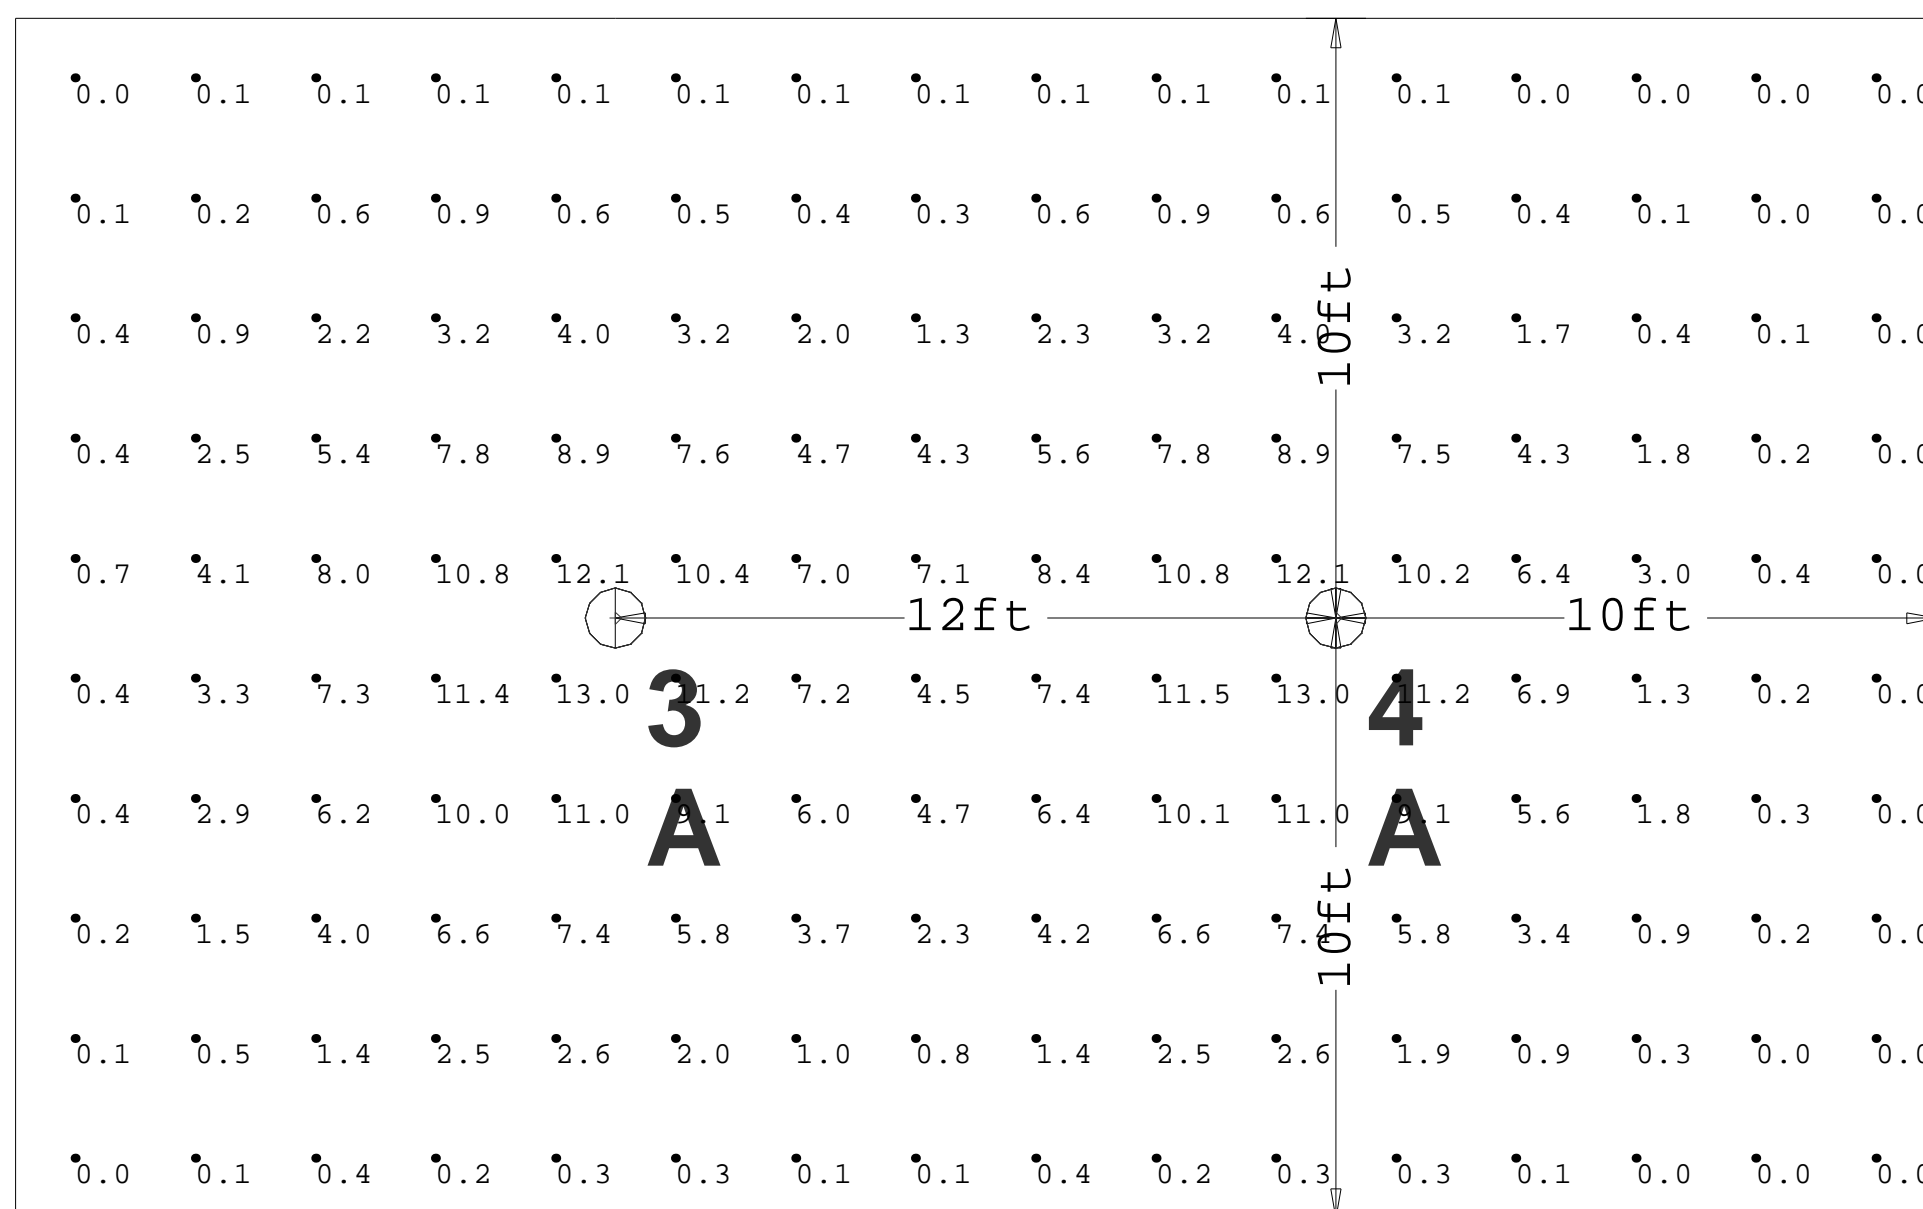

- DUE TO CHANGING LIGHTING ORDINANCES IT IS THE CONTRACTORS RESPONSIBILITY TO SUBMIT THE SITE PHOTOMETRICS AND LUMINAIRE SPECS TO THE LOCAL INSPECTOR BEFORE ORDERING TO ENSURE THIS PLAN COMPLIES WITH LOCAL LIGHTING ORDINANCES.
 - THIS LIGHTING DESIGN IS BASED ON INFORMATION SUPPLIED BY OTHERS. CHANGES IN ELECTRICAL SUPPLY, AREA GEOMETRY AND OBJECTS WITHIN THE LIGHTED AREA MAY PRODUCE ILLUMINATION VALUES DIFFERENT FROM THE PREDICTED RESULTS SHOWN ON THIS LAYOUT.
 - THIS LAYOUT IS BASED ON .IES FILES THAT WERE LAB TESTED OR COMPUTER GENERATED. ACTUAL RESULTS MAY VARY.

TECHLIGHT

2707 SATSUMA

DALLAS, TX
75229

Project:

**LED
INGROUND
25' FLAG
LIGHTING**

Notes:

FILE:

led25'flag.agi

Date:

12-2-11